

ECONOMIC BENEFITS FROM LOAD MANAGEMENT IN A CARPENTRY INDUSTRY

Stig-Inge Gustafsson,
IKP / Energy Systems and Wood Technology
Institute of Technology,
S 581 83 Linköping, Sweden

Abstract

As a result of a National Referendum and a subsequent parliament decision Sweden will phase out its nuclear power stations before year 2010. This source of electricity accounts for about half the total electricity usage and therefore other sources must be constructed, or the country must use less electricity. One way to accomplish this, according to economic theory, is to increase the price of electricity, and we will probably be subject to such actions, at least if there is a risk of a shortage of electricity. Hitherto, most interest for saving energy has been emphasised on space and domestic hot water heating in buildings. The major part of electricity, however, is used in industry, and therefore worth studying in more detail. One small carpentry plant which manufactures wooden staircases and fibre board panels for ceilings has been studied. Using monitored data for one year of their electricity usage and costs, the amount of money which could be saved by the owner of the factory, if different load management measures had been applied, has been calculated. Thus it was possible to find the maximum cost for equipment that can turn off some processes, such as timber dryers, for short periods.

Key words

Load management, Carpentries, Electricity, Kiln Dryers, Economy

INTRODUCTION

According to economic theory, the cost for using e. g. electricity influences usage in a significant way. If the price goes up the end user consumes less and the opposite is of course also valid. This has led to an increased interest in spot-price electricity tariffs, see References [1], [2] and [3]. The ordinary managers of many small industries, however, are not experts in energy issues, and therefore they just pay their bills without much consideration. Price information therefore does not affect the end use consumer and subsequently no electricity is saved. In Sweden wood manufacturing plants are very common and usually sited in rural areas. The managers frequently hesitate to use expertise found

in universities and institutes of technology even if they know who to contact. In order to improve this situation ARBIO, the Employers' Association of the Swedish Wood-Products Industry, have funded education and research in wood technology at the Institute of Technology in Linköping, Sweden. One of the first companies to attract our interest was a very small plant with about 10 employees, which is sited in Rydsnäs about 300 kilometres south of Stockholm. The energy usage, i.e. electricity, at the above company as well as two other companies in Linköping, has been the subject of one earlier study, see Reference [4]. The reference shows the electricity use for only a short period of time and only the total consumption of electricity was dealt with. There was no "specifying of usage" for different equipment such as the transport system for wood residuals in the form of saw dust, chips etc. However, we were able to show that the company had too large a tariff from the electricity utility. By changing such, from one based on 150 kW to the actual requirements of, about 80 kW, the owner saved about 25 % of the electricity cost. Note that it was a measure of administration and hence not a single kWh was saved. Encouraged by this result, studies were continued.

CASE STUDY

As mentioned above the electricity consumption has been monitored for one year at Rydsnäs Carpentry Ltd. Values are shown in Figure 1 in a so called "duration graph" i.e. they are depicted in descending order.

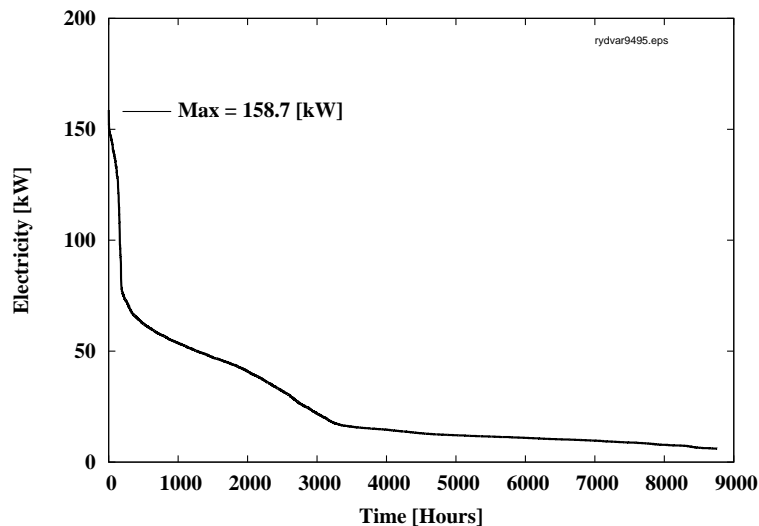


Figure 1: Duration graph for Rydsnäs Carpentry Ltd.

It is apparent from the figure that there is a very thin peak where all the highest values are located. The main reason for load management is to reduce this peak by moving the electricity demand to later hours. The energy amount in the peak is very small and therefore it should be possible to reduce the demand and hence the electricity cost.

The electricity tariff

The electricity subscription applicable for Rydsnäs Carpentry Ltd is based on a time-of-use rate where the utility charges a high cost for each kWh of electricity during day time, 06.00 to 22.00 hours. From October to April such cost was 0.415 SEK. (One UK £ equals about 10 SEK.) In the middle of the night, i. e. between 22.00 to 06.00 hours, cost is reduced to 0.308 SEK/kWh. Saturdays and Sundays are likewise low tariff periods. From May to September the cost is even lower, i. e. 0.215 SEK/kWh irrespective of the time and day. The main emphasis of this study, however, is the demand charge which in 1994 was 430 SEK/kWh. If one could save or transfer the kWh used when the load is at its highest level, each of these kWh has a value 200 times higher than the ordinary cost for electricity. This because the utility calculates a mean average of the four largest values in kWh for the total year. However, only one value between May to August can be included.

Monitored electricity use and load management

Table 1 shows values from the first complete month, i.e. April 1994, during the monitoring period.

Hour nr	Date and Time	Weekday	Value in [kW]
417	18th 09.00	Monday	70.1
416	18th 08.00	Monday	67.4
466	20th 10.00	Wednesday	64.2
153	7th 09.00	Thursday	63.8
465	20th 09.00	Wednesday	62.9
441	19th 09.00	Tuesday	62.5
135	6th 15.00	Wednesday	61.8
442	19th 10.00	Tuesday	61.1
633	27th 09.00	Wednesday	61.1
418	18th 10.00	Monday	60.3

Table 1: The ten largest values of electricity demand in kW for April 1994, Rydsnäs Carpentry Ltd.

Firstly, note that the maximum demand in April 1994 was 70.1 kW, i.e. far from the subscribed 150 kW mentioned above. Secondly, if a load management system had been used to decrease the load on April 18, at 09.00 by say 10 kWh and had added this energy to the next hour, i.e. hour nr 418, this would have aggravated the problem. At that hour the load was already 60.3 kW and an added 10 kWh would result in a load of 70.3 kW which is higher than that of hour nr 417. On the other hand, if the equipment had cut off only 5 kW at hour 417 the position would be improved because hour 418 would no longer have been among the four largest values of interest. Therefore, the magnitude of the "cut off" load has importance for the economic situation. If the "cut off" could be postponed two hours, instead of one, one must examine what happened at hour 419. A closer look at the data set showed that the load had decreased to only 10.2 kW and there would be no obstacle to adding 10 kWh in that hour. It is obvious that the length of the period of possible postponement is

of vital importance as well. Of course, it would have been possible to cut off for instance 10 kW in hour nr 417 and only add 7.1 kWh to hour 418 and the rest at nr 419. The load at hour nr 418 would then equal that in hour nr 416. It would be preferable, however, to reduce the load so much that the resulting subsequent loads are lower than the top four hours, which would result in a substantial average decrease.

One of the major problems is that one does not know in advance exactly what will happen the next hour. Only when it is lunch time or the working day is over may one assume that there is no risk of moving kWh to later hours. By studying the electricity load pattern one is sometimes able to see when maximum loads will probably occur. The hours from 08.00 to 10.00 seem to be represented more often in Table 1 than other time segments. In small factories such as the one studied here, load management equipment must be very cheap and therefore no expensive computer could be used for this purpose. There is a need, however, for a device that counts the pulses from the electricity meter and turns off equipment when the added kWh exceeds the last maximum value. In order to clarify the situation one must study the first hours in April, see Table 2.

Time	Demand [kW]	Time	Demand [kW]
00.00-01.00	10.9	06.00-07.00	9.6
01.00-02.00	10.7	07.00-08.00	9.3
02.00-03.00	10.5	08.00-09.00	9.3
03.00-04.00	10.6	09.00-10.00	9.4
04.00-05.00	10.4	10.00-11.00	9.7
05.00-06.00	10.0	11.00-12.00	9.8

Table 2: Electricity demand in kW the first hours of April 1, 1994

April 1 in 1994 was a Friday but because it was Easter all workers were free and only some of the equipment which is never turned off was in use. Hence, the electricity demand was as low as 10.9 kW the first hour. Load management in these hours is of no economic interest because the owner of the factory is charged a fee for at least 60 % of the subscribed amount, i. e. 48 kW. The load management equipment therefore must have a default limit of 48 kW, and if the demand is lower, no actions should be taken at all. If there is no such limit, the first hour will always be subject to load management. The first occurrence when demand was higher than 48 kW emerged between 06.00 and 07.00, April 5, which was the first working day that month. The load was 54.6 kW and therefore the load management device came into operation. If it was possible to postpone 10 kW to the next hour between 07.00 to 08.00, the load that hour would increase to 60.9 kW which was not exceeded until 14.00 the next day. This time, 10 kW could be postponed without exceeding the earlier level. The same is valid for the next peak, i.e. April 7, at 09.00. The fact is that only one more peak that month would be of interest for peak shaving and such occurred on April 18, between 07.00 to 08.00, see Table 1. Only a few hours during each month will thus be subject to load management and the negative consequences will hence be minute.

Load management economy

It is most important, however, to choose demand saving measures with great care. As is shown in the example above, load management may make the situation worse if saved kWh must be used the next hour. This is shown in more detail in Table 3 where we have examined the whole year, from March 19, 1994 to March 20, 1995.

Level [kW]	Hits [Nr]	New demand [kW]	Demand cost [SEK]
0	-	(152.0)	65,370
1	89	151.1	64,962
5	67	150.6	64,790
10	40	154.8	66,564
15	37	159.3	68,499
20	34	161.1	69,284
30	32	165.8	71,305

Table 3: Load management for different levels in kW, number of "hits" and electricity demand cost in SEK. Load postponed one hour

No default limit in kW for the load management equipment was used, and therefore the system operated frequently at the beginning of the months and more seldom at the end of them. The new demand is calculated as the average of the four largest values during the year for each month, this according to the tariff. The demand cost was 430 SEK/kW.

From the table it is obvious that not much money could be saved by the use of too simple a device. Note that the load increased for the levels 20 and 30 kW respectively. Only 580 SEK differs between the lowest cost and that where no system was used at all, compare line 1 and 3 in Table 3. Assuming that the equipment could be used for five years and, further, a real discount rate of 5 %, would result in a net present value of about 2,500 SEK which should be an upper cost limit for the peak shaving system described above.

Suppose there was a more intelligent system in use, where it was possible to add only a part of the saved kWh from one hour to the next, and the rest to the following hours and so on. In Table 1 this could be described as cutting off for instance, 10 kW in hour 417, and only adding 2.7 kWh at hour number 418 and the rest, 7.3 kWh at hour number 419. Such is shown for the total year in Table 4.

The lowest cost which emerges in line 3, see Table 4, has now changed to 63,748 SEK, i.e. the savings are three times higher than found in Table 3. A present value calculation shows that about 7,000 SEK could be invested and the equipment would still be profitable. A three hour postponement of shaved peaks does not change the situation very much. The first two levels are identical, i. e. 151,0 and 148.3 kW while the 10 kW level results in a small decrease to 150.6 kW. For levels 20 and 30 kW, respectively, the situation is aggravated and the resulting loads after peak shaving are higher than for a postponement of two hours. Load management has therefore the potential to be profitable but the equipment must be "finely tuned" for each factory in order to achieve the best result. In our case only low levels of peak shaving, about 3 % of the total load,

Level [kW]	Hits [Nr]	New demand [kW]	Demand cost [SEK]
0	-	(152.0)	65,370
1	156	151.0	64,940
5	138	148.3	63,748
10	135	153.4	65,962
15	130	155.0	66,662
20	126	153.5	65,983
30	79	157.4	67,673

Table 4: Load management for different levels in kW, number of "hits" and electricity demand cost in SEK. Load postponed two hours if applicable

were found profitable.

KILN DRYERS

One process was identified at the Rydsnäs factory which was probably suitable for load management, i.e. two kiln dryers for wood timber. The dryers are electrically heated even though the factory has a boiler fired with wood residuals, such as saw dust. The question is if the kilns are used in such a way that load management would be of interest. The manager of the factory inserts planks, mostly pine, in large batches of about 6 m³. The temperature inside the kilns is about 40 °C. One of these batches then yields enough raw material for several weeks. Figure 2 shows the electricity demand for a drying cycle.

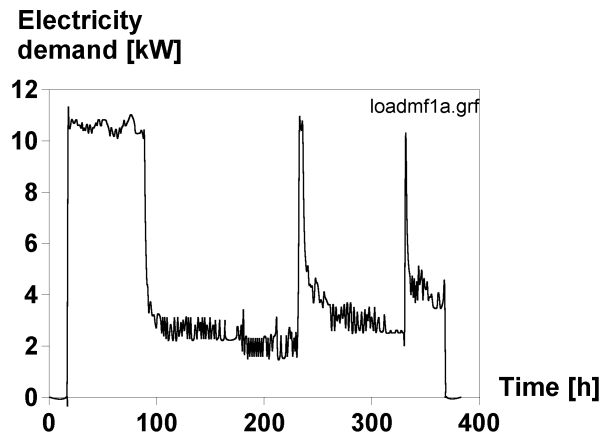


Figure 2: Electricity demand for the kiln dryer, Rydsnäs Carpentry Ltd, November 28 - December 13, 1994

Figure 2 shows that the electricity demand is about 11 kW at the beginning of a drying cycle. This level is constant for about 100 hours when the demand

drops to about 3 kW. There are also relatively short peaks after 250 and 350 hours respectively. The cycle in its entirety lasts about 375 hours. November 28, 1994, i.e. when the cycle started, was a Monday. If the dryer had been put into operation on the earlier Friday instead, the added ten kW demand would have been less negative for the factory owner because between Friday night and Monday morning the total load was very low. As has been shown above a load management system, where about 5 kW could be transferred to later hours, would be profitable. The wood in the dryer has a very high heat capacity and therefore the temperature would not decrease very much even if the kiln was to be turned off for a few hours or operated at lower power. The next drying cycle was initiated about three weeks later. Unfortunately, the monitoring period for the electricity consumption in the kiln dryer was much shorter than the total demand monitoring period. It is therefore not possible to calculate the exact savings in SEK during one year. A closer look at the data files revealed that November 1994 was not of interest for peak shaving because the maximum load then was only 80.4 kW. We focused our attention instead on the months of January, February and March, 1995, when the maximum demands were 149.4, 158.7, and 158.7 kW respectively. The first drying cycle in January started January 1 but lasted only four days and then the total load was too small for beneficial load management as was also the case for the next two cycles. The fourth cycle started on January 26 but it was not until January 31, at 09.00, that a very high load occurred at the same time as the drying equipment was operating. The time segment of interest is shown in Table 5.

Time	Total [kW]	Kiln Dryer [kW]	Time	Total [kW]	Kiln Dryer [kW]
05.00-06.00	25.4	1.9	11.00-12.00	130.9	2.1
06.00-07.00	26.9	2.6	12.00-13.00	78.3	2.3
07.00-08.00	52.8	2.7	13.00-14.00	65.6	2.6
08.00-09.00	140.8	2.4	14.00-15.00	73.6	2.6
09.00-10.00	149.4	2.0	15.00-16.00	76.3	2.6
10.00-11.00	140.1	2.7	16.00-17.00	72.8	1.6

Table 5: Total electricity demands and drying equipment demands for January 31, 1995, Rydsnäs Carpentry Ltd.

In Table 5 a peak occurs between 08.00 and 12.00 and the fact is that this peak was decisive for the total month maximum value. Earlier in the month a load of 144.5 kW had emerged but then the kiln dryer was not operating. However, if a load management system had been installed about 5 kW could have been postponed from 09.00 to 10.00 to later hours and these two hours would have been enough. In February the maximum load was 158.7 kW but once again the kiln dryer was turned off on that specific occasion. Unfortunately, no registrations were made for the kiln during March 1995. The fact is that the dryers, albeit their potential for load management, are used too seldom for beneficial load management. The fact that there are two dryers probably improves the situation but nonetheless no substantial amount of money is likely to be saved.

CONCLUSIONS

We have shown that load management, where part of the electricity load is postponed to later hours, has a potential for reducing the electricity bill for a studied company. The savings, however, are surprisingly small, about 7,000 SEK or £700 calculated as a net present value, because saved electricity one hour will aggravate the situation at later hours. Therefore, the resulting maximum load was many times higher after load management had been in operation, than it was originally. An optimum level for load management was found to be about 5 out of a total of 150 kW or about 3 %. It was also found very important to find equipment in the plant that could be turned off for more than one or two hours. Plausible equipment for such in the factory were two kiln dryers for wood timber with an installed power of about 11 kW each. However, a closer study showed that they were used too seldom. The studied dryer was in operation only once in the examined year at the same time as a total electricity demand peak occurred, which was significant for the electricity. Hence, load management in practice is a very subtle task where measures for peak shaving must be studied in detail in order to be profitable. One way to accomplish such is to study how different equipment in the plant is actually used for a rather long period of time, say two months. The owner, or manager, of the factory must therefore check how often a machine is used, and turned off, when it is utilised in a normal way. It is also essential to monitor the actual need for electricity during the period when it is in operation. For practical reasons load management equipment must include a default lowest level for cutting peaks. Otherwise the system will operate very frequently at the beginning of each month without any benefits for the owner.

References

- [1] McDonald J. R., Whiting P. A. and Lo K. L. Optimal Reaction of Large Electrical Consumers in Response to Spot-Price Tariffs. *Electrical Power and Energy Systems*, 16(1):35–43, 1994.
- [2] McDonald J. R., Whiting P. A. and Lo K. L. Spot-Pricing: Evaluation, Simulation and Modelling of Dynamic Tariff Structures. *Electrical Power and Energy Systems*, 16(1):23–34, 1994.
- [3] Renar J. and Tomsic M. Optimal Electric Power Conservation Investments Using Utility Avoided-Costs. *Energy - The International Journal*, 17(5):499–508, 1992.
- [4] Gustafsson S.I. and Probert S.D. Electricity use in Swedish Carpentry Industry. *Applied Energy*, 52(1):73–85, 1995.