

Volume 7 Number 4

Boyl

6

1987

---

# HEAT RECOVERY SYSTEMS & CHP

combined heat & power

---

Editor-in-Chief: **D.A. REAY**  
*David Reay & Associates,*  
*Tyne & Wear, U.K.*



**PERGAMON PRESS**

OXFORD · NEW YORK · BEIJING · FRANKFURT · SÃO PAULO · SYDNEY · TOKYO · TORONTO

## DIFFERENTIAL RATES FOR DISTRICT HEATING AND THE INFLUENCE ON THE OPTIMAL RETROFIT STRATEGY FOR MULTI-FAMILY BUILDINGS

STIG-INGE GUSTAFSSON, BJÖRN G. KARLSSON and BERTIL H. SJÖHOLM  
Institute of Technology, Department of Mechanical Engineering, Energy Systems,  
S-581 83 Linköping, Sweden

(Received 8 December 1986; received in revised form 9 January 1987)

**Abstract**—When renovating existing multi-family buildings it is very important to implement the best retrofit strategy possible in order to minimize the remaining life-cycle cost for the building. If the building is heated with district heating this strategy of course changes due to the energy rate used by the utility. It is also very important for the utility that the consumer is encouraged to save energy when there is a need for it, i.e. during peak load conditions. Our paper shows that an accurate cost differential rate provides all these facilities.

### INTRODUCTION

Since 1985 a research project has run concerning retrofitting of multi-family residences. The project is financed by the Swedish Council for Building Research and the community of Malmö, Sweden. The scope of the project is to find out how each unique building shall be retrofitted in order to minimize its life-cycle cost, i.e. to search for the optimal retrofit strategy. This paper however, deals only with district heated buildings and how the retrofit strategy changes if the district heating utility implements a differential rate for the energy delivered.

When district heating systems were introduced in Sweden the heat was produced by burning heavy oil. This kind of oil was cheaper than the quality that could be used in smaller oil boilers, installed in ordinary multi-family buildings. The cheaper oil made the district heating plants profitable in spite of the higher investment costs. The consumers paid for the energy according to a rate consisting of four parts:

- Connection fee.
- Fixed fee.
- Power related fee.
- Energy fee.

The district heating plant only used oil for heating and thus the cost for producing a new unit of energy was the same whether it was winter or summer. After the oil crises the situation became different. Many systems are now heated with refuse, electricity, coal, wood chips etc. The cost for producing one more unit of energy thus differs a lot due to the season of the year as the mix of energy input changes. In the summer the plant can produce almost all of the energy by burning refuse. The cost for producing an extra unit of energy is in such cases of the order of  $0.01 \text{ SEK kW}^{-1} \text{ h}^{-1}$ . During the winter however, the plant has to burn oil and the cost for producing one more unit of energy is thus about  $0.20 \text{ SEK kW}^{-1} \text{ h}^{-1}$ .

The consumer who wants to save energy can choose between a variety of energy retrofits, e.g. insulation measures, caulking windows and doors, installing an exhaust air heat pump, and can also use sun collectors to produce his own energy in the building. It is obvious that if the district heating company is using ordinary rates it is not important to the consumer if he saves energy during the summer or in the winter. The money saved is identical. The district heating utility however wants the consumer to save energy during the winter because then they are burning oil in the plant, which is expensive. During the summer the company must get rid of the refuse and if they cannot burn it they have to bury it in the ground. One means to achieve such a behaviour from the consumer is to implement differential rates.



## MARGINAL COST THEORY

Using the cost for the last unit of energy, produced in the utility, as the price for the total amount of energy delivered, is called marginal cost pricing. The fee is thus the same for all the energy produced in the plant. This is regardless of the fact that almost all of the energy has been produced with a cheaper fuel than is used at the top, on this special occasion. Thus, if any of the heat is produced from expensive oil, all the heat delivered at that moment shall have the oil marginal cost. The utility will therefore earn money, because a lot of the energy is produced with refuse and wooden chips. If the consumers find this oil marginal cost too high they want to use less energy and will thus turn off the heating equipment or at least reduce its use. This also means that, according to the national economic theory, the plant will operate in the most efficient way.

The marginal cost pricing shall be used when the facilities are produced in a system which requires large capital investments and if the producing utilities only with a great difficulty can be used for other production. This is the precise situation for district heating plants. For those readers who want a more elaborate discussion about the marginal cost theories Ref. [1] can be recommended.

A rate that is constructed in the way discussed above is called a cost differential rate, or CDR. However, it is very hard to make the consumer aware of the marginal cost at each moment. New meters have been constructed but they are not in common use. The second best solution is thus to implement a time-of-use rate, TOU. The price for the energy then varies during the year. In the winter the energy price can correspond to the oil price and during the summer to some cheaper fuel. In Malmö, Sweden, the utility has introduced a rate according to such a concept, but it is of course possible to have several price levels.

## DURATION CURVES

One means to depict the situation both for the energy producing plant and the consumer is to use load duration curves. In Fig. 1 the curve is shown for a district heating plant.

The plant in Fig. 1 is burning refuse all over the year. This is so because the fuel is almost free of cost. It is also hard to save the refuse for the winter because of hygienic reasons. The second cheapest fuel is wooden chips which are used during almost all the year. The most expensive fuel, oil type 2, is used only during peak load conditions. It is also important to note the installation cost for different boilers used in the plant (Fig. 2).

The cheapest equipment is the oil boiler while the most expensive is the refuse burning facility. Having only a small amount of energy to deliver, the oil boiler should be used. As the amount of energy increases it is more profitable to invest in a coal-fired boiler and so on. However, it is not possible to use only refuse in the plant because the amount of refuse is limited. A mix of different fuels therefore have to be used.

It is also important to examine how different retrofits on a building affect the duration curve (Fig. 3).

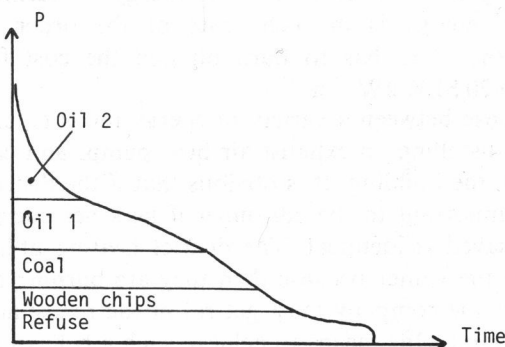


Fig. 1. Load duration curve for a district heating plant [2].

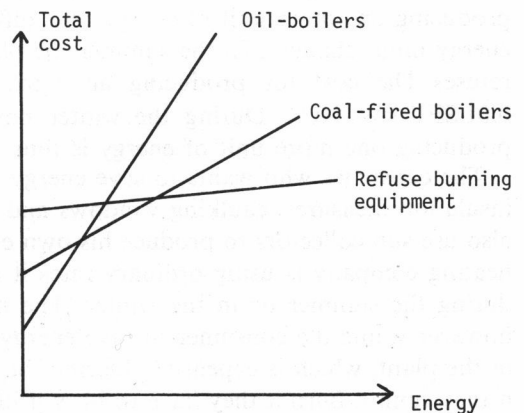


Fig. 2. Total cost for district heating boilers.

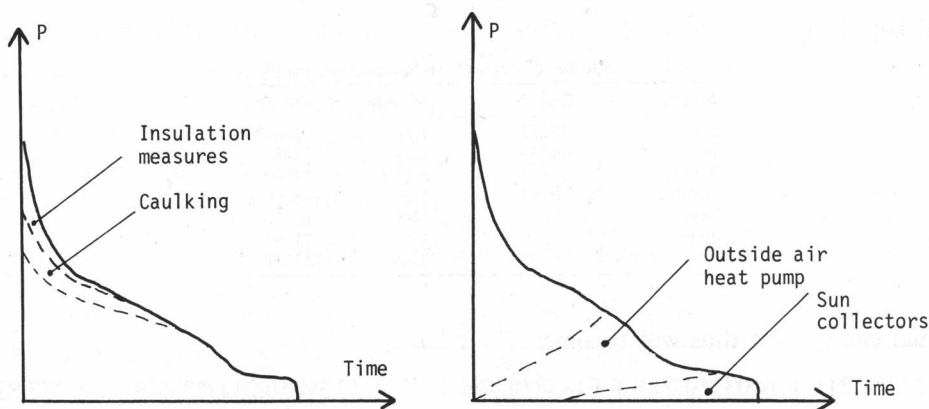


Fig. 3. Duration curves for different retrofits [2].

Of great importance also are the duration curves for competing energy producing facilities that can be installed in the building. It is obvious that if a lot of landlords invest in sun collectors and outside air heat pumps this can result in negative consequences for the district heating utility.

#### COMPARING RATES—NORMALIZATION

Comparing different types of rates makes it important to ascertain that it is only the differences in the rate construction that shall be compared. The price level of course must be the same. This can be provided in two different ways. The first one considers the fact that one energy unit consumed uniformly during the year shall cost the same independent of the rate. One example is the consumption of hot water. The annual cost must be the same whether the fixed rate or the differential type are used. However, this type of normalization gives a higher income to the power company for the true heating load. Much more energy is used during the winter with a high price per unit of energy. Thus this is not a recommendable solution. The other kind of normalization achieves that the district heating company will get the same income for identical heat consumers independent of the construction of the rate.

We will give an example of the two types of normalization. In Malmö, the marginal costs in 1985 were:

Table 1. Marginal energy cost in Malmö, Sweden (1985).  
District heating [2]

Month	Rate (SEK kW <sup>-1</sup> h <sup>-1</sup> )	Month	Rate
Jan.	0.211	July	0.116
Feb.	0.211	Aug.	0.116
March	0.198	Sept.	0.116
April	0.116	Oct.	0.116
May	0.116	Nov.	0.140
June	0.116	Dec.	0.211

In this case we have the differential rate and have to transform it to a fixed one. The first type of normalization is shown using the heating of hot water. Assuming that a building consumes 288 GJ (=80,000 kWh) each year for this, the annual cost will become:

$$80000 \cdot (0.211 \cdot 744 + 0.211 \cdot 678 + 0.198 \cdot 744 + \dots + 0.211 \cdot 744) : 8766 = 11840 \text{ SEK.}$$

The figures 744, 678... are the number of hours in each month of the year and 8766 the total number of hours during one year. The annual mean value for the energy is 0.148 SEK kW<sup>-1</sup> h<sup>-1</sup>, which gives us the fixed rate.

A normalization of the other type considers the actual heat load due to the climate. The heat load values are taken from [3] where a fictional building is described. The total transmission factor is 3499 W K<sup>-1</sup>, including 1267 W K<sup>-1</sup> for the ventilation system. In Malmö the climate can be

described by:

Table 2. Number of degree h in Malmö, Sweden [3]

Month	Deg. h	Month	Deg. h
Jan.	15252	July	2083
Feb.	14035	Aug.	2455
March	13838	Sept.	4680
April	10080	Oct.	8258
May	6696	Nov.	10872
June	3600	Dec.	13392
		Total	105241

The annual energy cost thus will become:

$$(15252 \cdot 0.211 + 14035 \cdot 0.211 + 13838 \cdot 0.198 + \dots + 13392 \cdot 0.211) \cdot 3.499 = 61,777 \text{ SEK.}$$

The mean value for the energy price is thus  $0.168 \text{ SEK kW}^{-1} \text{ h}^{-1}$ .

The combination of climate load and a uniform load (hot water), will make the mean value slightly lower or:

$$(0.168 \cdot 3.499 \cdot 105241 + 80000 \cdot 0.148) : (3.499 \cdot 105241 + 80000) = 0.164 \text{ SEK kW}^{-1} \text{ h}^{-1}.$$

A fixed rate of  $0.164 \text{ SEK kW}^{-1} \text{ h}^{-1}$  thus will give the heating utility exactly the same income as if the differential rate was used.

#### RETROFIT MEASURES

Retrofit measures done to the climate envelope affect the total transmission factor,  $3499 \text{ W K}^{-1}$ . In [3] the optimal extra insulation thickness for the attic floor in our fictional building has been calculated to be 0.17 m, however not with exactly the same district heating rate. Making such an insulation retrofit decreases the transmission factor above to  $2880 \text{ W K}^{-1}$ . The cost for energy with a fixed rate of  $0.164 \text{ SEK kW}^{-1} \text{ h}^{-1}$  reduces from 73 645 to 62 942 SEK or with 10 702 SEK. Using the differential rate in Table 1 the energy cost will become

$$(61\,777 : 3.499) \cdot 2.880 + 80000 \cdot 0.148 = 62\,699 \text{ SEK.}$$

The money saved is 10 946 SEK or a little more than by using the fixed rate. The fact is that one will save only about 3% more with this differential rate. It does not matter how extensive the insulation retrofit strategy is. This is so because the difference between the high price and the low price is too small. However, as is shown in [2], it is not possible to encourage top peak saving, e.g. insulation, only by implementing a differential rate. In such a case the level of the rate has to be increased, i.e. the energy has to be more expensive.

Another retrofit designed to save energy is the exhaust air heat pump. If the heat pump is installed to produce hot water the profitability is lower if a differential rate is implemented. In our fictional case from [3] the heat pump can deliver 374 GJ (= 104 000 kWh) of heat. However there is only a need for 288 GJ and thus the money saved with a fixed rate is

$$80000 \cdot 0.168 = 13\,440 \text{ SEK.}$$

With the differential rate the amount is

$$80000 \cdot 0.148 = 11\,840 \text{ SEK.}$$

The exhaust air heat pump thus has a lower profitability with a differential rate.

One more heat producing facility has been examined, i.e. solar collectors. Of course these work best in the summer and as a result, will have disadvantages from a differential rate. In [2] an example is shown using a collector that saves 36% of the hot water energy, mostly during the summer. The savings were only about 70% with the differential rate compared to the fixed one.

From this example it is obvious that implementing a differential rate encourages insulation measures and gives disadvantages to competing heat producing facilities. Using a rate which has larger differences between the high and the low prices will emphasize this. In [2] we have shown

an example from the district heating company in Linköping, Sweden. The fuels in the plant are:

—Refuse	0.01 SEK kW <sup>-1</sup> h <sup>-1</sup> .
—Wood chips	0.10 SEK kW <sup>-1</sup> h <sup>-1</sup> .
—Coal	0.11 SEK kW <sup>-1</sup> h <sup>-1</sup> .
—Electricity	0.10–0.15 SEK kW <sup>-1</sup> h <sup>-1</sup> .
—Oil	0.23 SEK kW <sup>-1</sup> h <sup>-1</sup> .

These prices were valid in 1985, and we have constructed a rate as follows:

Table 3. Constructed rate for district heating in Linköping [2]

Month	SEK kW <sup>-1</sup> h <sup>-1</sup>	Month	SEK kW <sup>-1</sup> h <sup>-1</sup>
Jan.	0.23	July	0.01
Feb.	0.23	Aug.	0.01
March	0.125	Sept.	0.10
April	0.110	Oct.	0.115
May	0.10	Nov.	0.125
June	0.01	Dec.	0.23

The insulation alternatives will with this rate be slightly more profitable. The most important thing is however that exhaust air heat pumps only save about 70% and sun collectors only about 25% of the money compared to the fixed rate.

As mentioned above the level of the rate has to be increased if top peak savings are to be encouraged. Assuming a rate with the price 0.25 SEK kW<sup>-1</sup> h<sup>-1</sup> during November to March and 0.06 SEK kW<sup>-1</sup> h<sup>-1</sup> else, the insulation measures get about 40% better profitability with this new differential rate. Unfortunately the competing heat producing equipment also get a better profitability but they still have a disadvantage compared to a fixed rate.

## CONCLUSIONS

Using a differential rate for the energy delivered from a district heating plant gives advantages to the district heating system. Competing energy producing equipment, e.g. sun collectors will have less profitability. If the rate level is constant the design of the rate has only a little importance to top peak energy saving measures. If the rate is increased insulation measures will be much more profitable but this also means that for example, exhaust air heat pumps get a shorter pay back period.

## REFERENCES

1. B. H. Sjöholm (1984) Influence of differential rates on heating systems. Dissertation No. 119, Division of Energy Systems. Department of Mechanical Engineering, The Institute of Technology, Linköping, Sweden.
2. S.-I. Gustafsson, B. H. Sjöholm and B. G. Karlsson (1985) Differential rates for district heating—An analysis of the consequences for retrofit measures in multi-family residences. Report No. LiTH-IKP-R-412. The Institute of Technology, Department of Mechanical Engineering, Linköping, Sweden (in Swedish).
3. S.-I. Gustafsson (1986) Optimal energy retrofits on existing multi-family buildings. Thesis No. 91. Division of Energy Systems. Department of Mechanical Engineering, Institute of Technology, Linköping, Sweden.